


3/1960
E 7.4.

1 W.P.
DWG. NO. 1517
RECORD 874

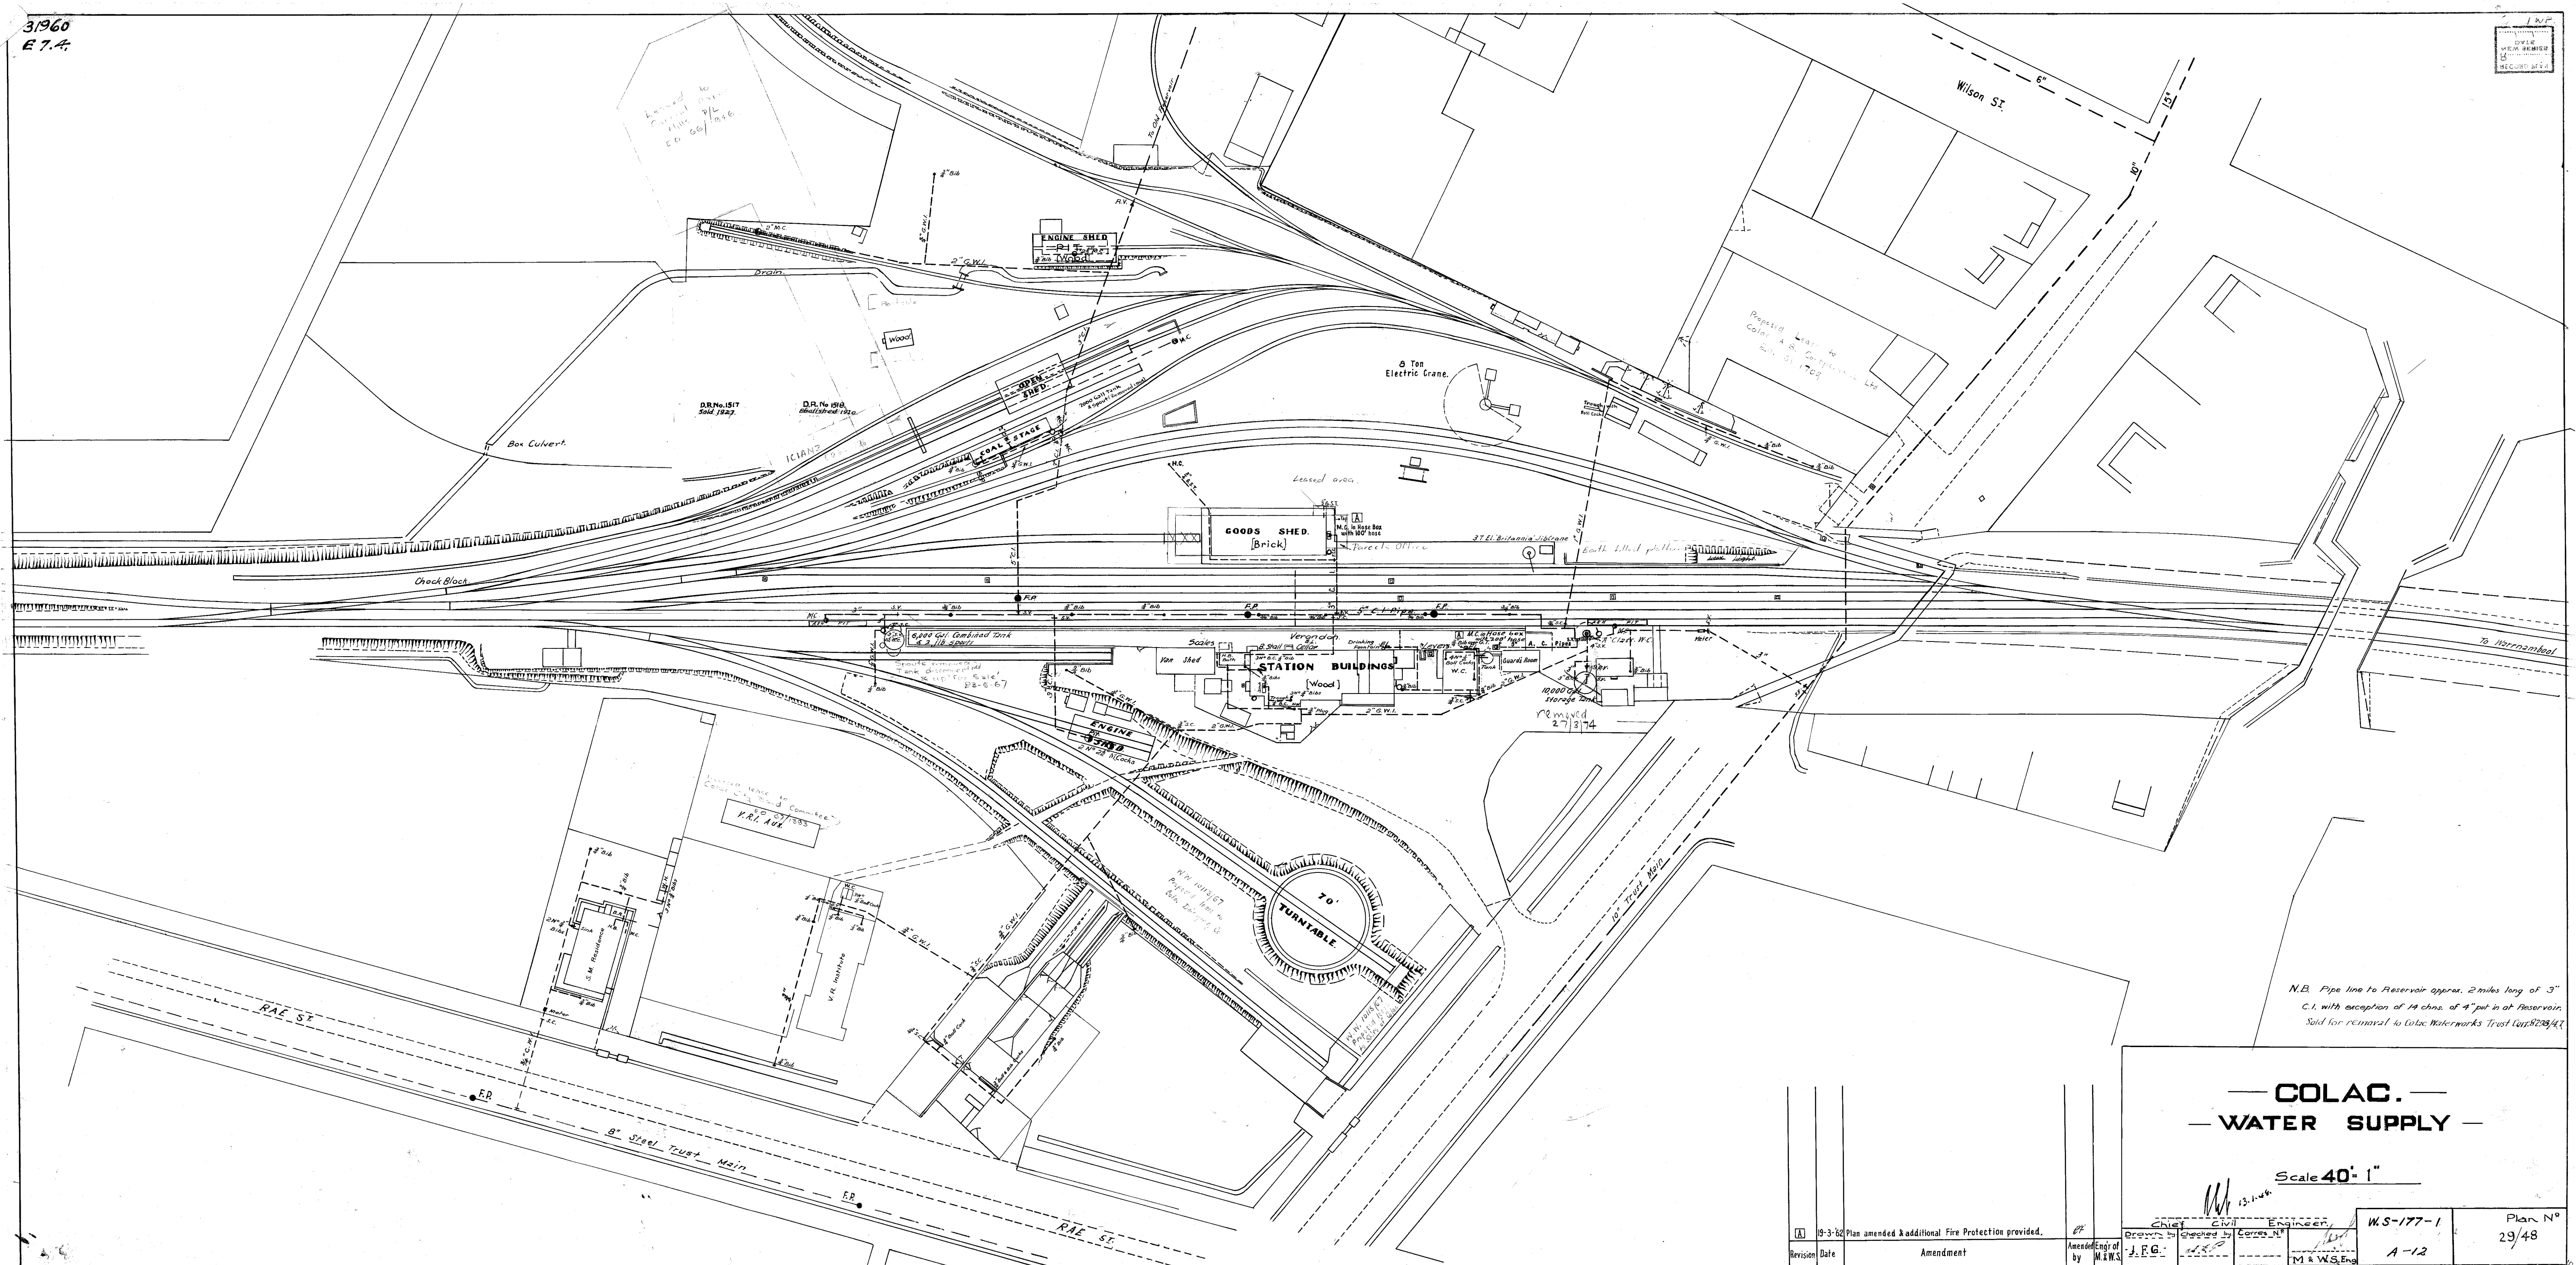

N.B. Pipe line to Reservoir approx. 2 miles long of 3" C.I. with exception of 14 chns. of 4" put in at Reservoir. Said for removal to Colac Waterworks Trust (1928/47)

— COLAC. —
— WATER SUPPLY —

Scale 40' = 1"

Revision	Date	Amendment	Checked by	Engineer of W.R.W.S.	Drawn by	Checked by	Corres. No.	Project No.	Plan No.
A	19-3-62	Plan amended & additional Fire Protection provided.	J.F.G.	M & W.S. Eng.	J.F.G.			WS-177-1	29/48
								A-12	

Chief Civil Engineer
13.1.48